



8165 E Kaiser Blvd. Anaheim, CA 92808  
www.lightlaboratory.com

Report No: L101605130

Date: 12/8/2016



NVLAP LAB CODE 200927-0

**Report No:** L101605130

**Prepared For:** Number Eight Lighting Company  
526 Portal Street, Cotati, CA 94931

**Model Number:** 803/K2-HI-15-XX/DIM1-8-1000/FR-P-1-WH

**Test:** Photometric/Electrical Test

**Standards Used:** Appropriate part or all test guidelines were used for test performed:  
*IESNA LM79: 2008* Approved Methods for Electrical and Photometric Measurements of Solid-State Lighting Products  
*ANSI NEMA ANSLG C78.377: 2008* Specification of the Chromaticity of Solid State Lighting Products  
*ANSI C82.77:2002:* Harmonic Emission Limits-Related Quality Requirements for Lighting Equipment

**Description of Sample:** Client submitted the sample. Catalog number is 803/K2-HI-15-XX/DIM1-8-1000/FR-P-1-WH . Received in working and undamaged condition. No modifications were necessary.

**Testing Condition:** Fixture is tested with no special conditions.

**Sample Arrival Date:** 10/31/16

**Date of Tests:** 12/5/16 - 12/8/16

**Seasoning of Sample:** No seasoning was performed in accordance with IESNA LM-79.

**Equipment List**

Equipment Used	Model No	Stock No	Calibration Due Date
Chroma Programmable AC Source	61604	PS-AC02	--
Yokogawa Digital Power Meter	WT210	MT-EL06-GB	2/10/17
Xitron Power Analyzer	2802	MT-EL02-2	12/22/16
BK PRECISION	1747	PS-DC04	12/8/16
Fluke Digital Thermometer	52k/J	MT-TP02-GB	12/8/16
LLI Type C Goniophotometer System	RMG-C-MKII	CD-LL04-GC	--
LLI 2M Sphere	2MR97	CD-SN03-S2	--
LLI Spectroradiometer	SPR-3000	MT-SC01-S2	Before Use

\*All Results in accordance to IESNA LM-79-2008: Approved Method for the Electrical and Photometric Testing of Solid-State Lighting.

**Test Summary**

<b>Manufacturer:</b>	Number Eight Lighting Company
<b>Model Number:</b>	803/K2-HI-15-XX/DIM1-8-1000/FR-P-1-WH
<b>Driver Model Number:</b>	INTUITIVE SYSTEMS ISD-601-1050-15-D
<b>Total Lumens:</b>	978.64
<b>Input Voltage (VAC/60Hz):</b>	120.00
<b>Input Current (Amp):</b>	0.13
<b>Input Power (W):</b>	15.04
<b>Input Power Factor:</b>	0.98
<b>Current ATHD @ 120V(%):</b>	8%
<b>Current ATHD @ 277V(%):</b>	N/A
<b>Efficacy:</b>	65
<b>Ambient Temperature (°C):</b>	25.0
<b>Stabilization Time (Hours):</b>	0:35
<b>Total Operating Time (Hours):</b>	1:10
<b>Off State Power(W):</b>	0.00

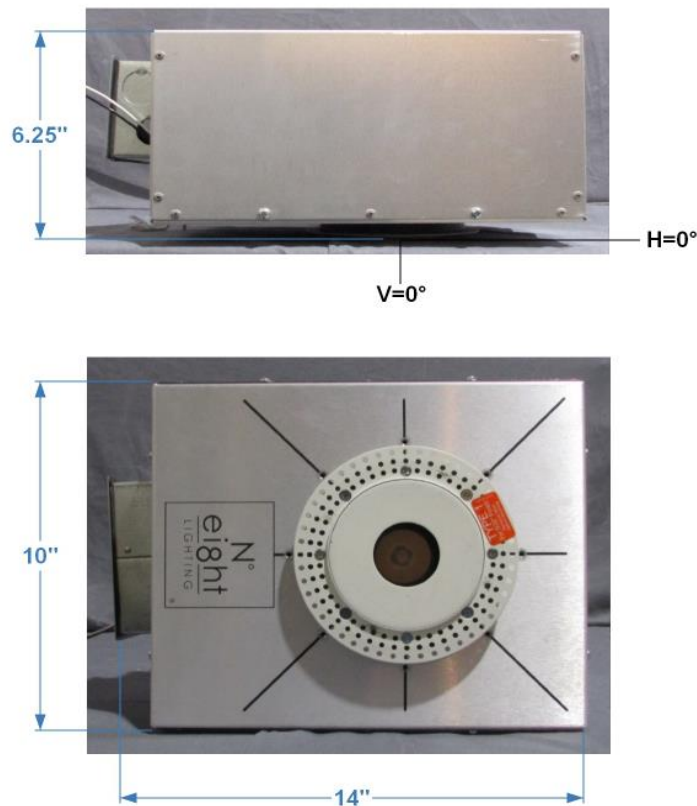


FIG.1 LUMINAIRE

\*All Results in accordance to IESNA LM-79-2008: Approved Method for the Electrical and Photometric Testing of Solid-State Lighting.

## Test Methods

### Photometric Measurements - Goniophotometer

A Custom Light Laboratory Type C Rotating Mirror Goniophotometer was used to measure candelas(intensity) at each angle of distribution as defined by IESNA for the appropriate fixture type.

Ambient temperature is set to 25°C and is measured from the center of the fixture, within 1ft from the outside of the fixture. Temperature is maintained at 25°C throughout the testing process and the sample is stabilized for at least 30mins and longer as necessary for the sample to achieve stabilization.

Electrical measurements are measured using the listed equipment.

### Spectral Measurements - Integrating Sphere

A Sensing Spectroradiometer SPR-3000, in conjunction with Light Laboratory 2 meter integrating sphere was used to measure chromaticity coordinates, correlated color temperature(CCT) and the color rendering index(CRI) for each sample.

Ambient temperature is set to 25°C and is measured from the center of the fixture, within 1ft from the outside of the fixture. Temperature is maintained at 25°C throughout the testing process and the sample is stabilized for at least 30mins and longer as necessary for the sample to achieve stabilization.

Electrical measurements are measured using the listed equipment.

### Disclaimers:

This report must not be used by the customer to claim product certification, approval or endorsement by NVLAP, NIST or any agency of Federal Government.

Report Prepared by : Keyur Patel

Test Report Released by:



Jeff Ahn  
Engineering Manager

Test Report Reviewed by:



Steve Kang  
Quality Assurance

*\*Attached are photometric data reports. Total number of pages: 9*



8165 E. Kaiser Blvd. Anaheim, CA 92808  
 p. 714.282.2270  
 f. 714.676.5558

# Photometric Test Report

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : L101605130.IES**

**DESCRIPTION INFORMATION (From Photometric File)**

IESNA:LM-63-2002  
 [TEST] L101605130  
 [TESTLAB] LIGHT LABORATORY, INC.  
 [ISSUE DATE] 12/08/2016  
 [MANUFAC] Number Eight Lighting Company  
 [LUMCAT] 803/K2-HI-15-XX/DIM1-8-1000/FR-P-1-WH  
 [LUMINAIRE] LED Recessed Fixed Position Downlight, 90+ CRI,  
 [MORE] 15° Beam Spread, 1.75" Aperture Trim  
 [BALLASTCAT] INTUITIVE SYSTEMS ISD-601-1050-15-D  
 [LAMPPOSITION] 0,0  
 [LAMPCAT] N/A  
 [OTHER] INDICATING THE CANDELA VALUES ARE ABSOLUTE AND  
 [MORE] SHOULD NOT BE FACTORED FOR DIFFERENT LAMP RATINGS.  
 [INPUT] 120VAC, 15.04W  
 [TEST PROCEDURE] IESNA:LM-79-08

**CHARACTERISTICS**

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	979
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	65
Total Luminaire Watts	15.04
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	0.32
Spacing Criterion (90-270)	0.32
Spacing Criterion (Diagonal)	0.32
Basic Luminous Shape	Circular
Luminous Length (0-180)	0.15 ft (Diameter)
Luminous Width (90-270)	0.15 ft (Diameter)
Luminous Height	0.00 ft

**LUMINANCE DATA (cd/sq.m)**

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	6885	6885	6885
55	3183	3183	3183
65	2880	2880	2880
75	4702	4702	4702
85	13964	13964	13964

IES INDOOR REPORT  
PHOTOMETRIC FILENAME : L101605130.IES

CANDELA TABULATION

	<u>0</u>
0.0	6968
1.0	6921
3.0	6497
5.0	5627
7.0	4485
9.0	3342
11.0	2413
13.0	1708
15.0	1247
17.0	904
19.5	592
22.5	352
25.5	222
29.0	132
33.0	68
37.5	29
42.5	11
47.5	5
55.0	3
65.0	2
75.0	2
85.0	2
90.0	0

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : L101605130.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	797.25	N.A.	81.50
0-30	922.39	N.A.	94.30
0-40	958.79	N.A.	98.00
0-60	971.50	N.A.	99.30
0-80	975.93	N.A.	99.70
0-90	978.64	N.A.	100.00
10-90	592.55	N.A.	60.50
20-40	161.54	N.A.	16.50
20-50	171.69	N.A.	17.50
40-70	15.08	N.A.	1.50
60-80	4.43	N.A.	0.50
70-80	2.06	N.A.	0.20
80-90	2.70	N.A.	0.30
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	978.64	N.A.	100.00

Total Luminaire Efficiency = N.A.%

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	386.09
10-20	411.16
20-30	125.14
30-40	36.40
40-50	10.15
50-60	2.56
60-70	2.37
70-80	2.06
80-90	2.70
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : L101605130.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0	
	RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100
1	115	113	111	109	113	111	109	107	107	105	104	103	102	101	100	99	98	96	96
2	111	108	105	102	109	106	103	101	103	101	99	100	98	97	97	96	95	93	93
3	108	103	100	97	106	102	99	96	99	97	94	97	95	93	95	93	92	90	90
4	105	99	95	92	103	98	95	92	96	93	91	94	92	90	93	91	89	88	88
5	102	96	92	89	100	95	91	88	93	90	88	92	89	87	90	88	86	85	85
6	99	93	89	86	98	92	88	85	91	87	85	89	87	84	88	86	84	83	83
7	96	90	86	83	95	89	85	83	88	85	82	87	84	82	86	84	82	81	81
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	79	79	79
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	80	78	76	75	75

POLAR GRAPH

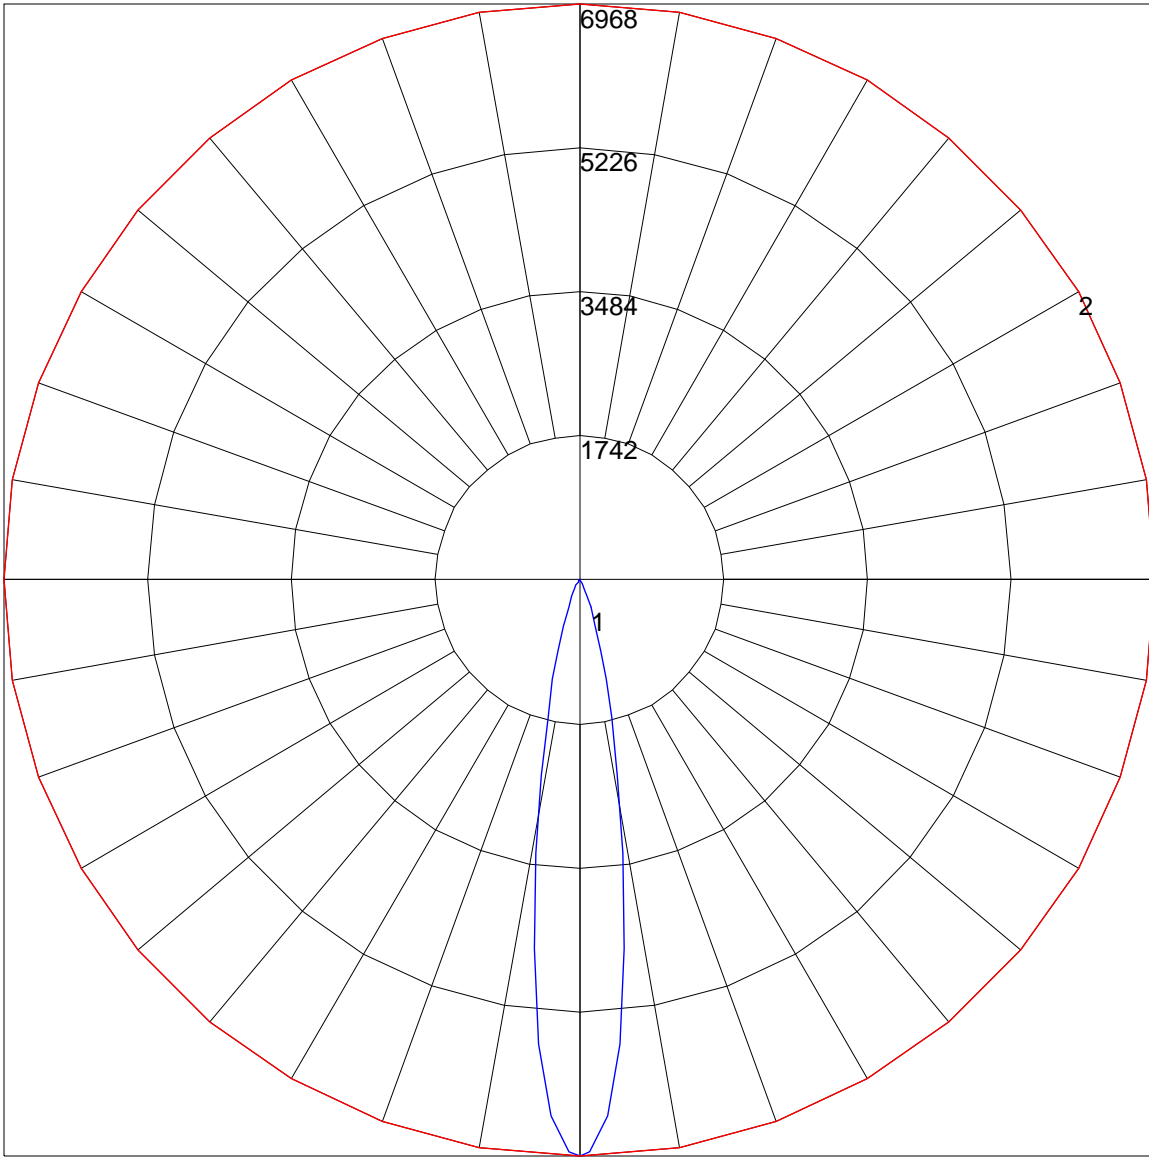

Maximum Candela = 6968 Located At Horizontal Angle = 0, Vertical Angle = 0  
# 1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (0) (Through Max. Cd.)



## SAMPLE Illuminance cone diagram

Mounting Height = 12 ft.

