



8165 E Kaiser Blvd. Anaheim, CA 92808  
 p. 714.282.2270  
 f. 714.676.5558

Report No: L101605110

Date: 11/8/2016



NVLAP LAB CODE 200927-0

**Report No:** L101605110

**Prepared For:** Number Eight Lighting Company  
 526 Portal Street, Cotati, CA 94931

**Model Number:** 803/K2-HI-40-XX/DIM1-8-1000/FR-LG-P-1-WH/NL

**Test:** Photometric/Electrical Test

**Standards Used:** Appropriate part or all test guidelines were used for test performed:  
*IESNA LM79: 2008* Approved Methods for Electrical and Photometric Measurements of Solid-State Lighting Products  
*ANSI NEMA ANSLG C78.377: 2008* Specification of the Chromaticity of Solid State Lighting Products  
*ANSI C82.77:2002:* Harmonic Emission Limits-Related Quality Requirements for Lighting Equipment

**Description of Sample:** Client submitted the sample. Catalog number is 803/K2-HI-40-XX/DIM1-8-1000/FR-LG-P-1-WH/NL . Received in working and undamaged condition. No modifications were necessary.

**Testing Condition:** Fixture is tested with no special conditions.

**Sample Arrival Date:** 10/31/16

**Date of Tests:** 11/8/16 - 11/8/16

**Seasoning of Sample:** No seasoning was performed in accordance with IESNA LM-79.

**Equipment List**

Equipment Used	Model No	Stock No	Calibration Due Date
Chroma Programmable AC Source	61604	PS-AC02	--
Yokogawa Digital Power Meter	WT210	MT-EL06-S1	11/18/16
Xitron Power Analyzer	2503AH	MT-EL01	11/30/16
ITECH DC Power Supply	IT6122	PSDC-03-S1	11/17/16
Fluke Digital Thermometer	52k/J	MT-TP02-GC	11/24/16
LLI Type C Goniophotometer System	RMG-C-MKII	CD-LL04-GC	--
LLI 2M Sphere	2MR97	CD-SN03-S2	--
LLI Spectroradiometer	SPR-3000	MT-SC01-S2	Before Use

\*All Results in accordance to IESNA LM-79-2008: Approved Method for the Electrical and Photometric Testing of Solid-State Lighting.

**Test Summary**

<b>Manufacturer:</b>	Number Eight Lighting Company
<b>Model Number:</b>	803/K2-HI-40-XX/DIM1-8-1000/FR-LG-P-1-WH/NL
<b>Driver Model Number:</b>	INTUITIVE SYSTEMS ISD-601-1050-15-D
<b>Total Lumens:</b>	913.00
<b>Input Voltage (VAC/60Hz):</b>	120.00
<b>Input Current (Amp):</b>	0.13
<b>Input Power (W):</b>	15.07
<b>Input Power Factor:</b>	0.98
<b>Current ATHD @ 120V(%):</b>	8%
<b>Current ATHD @ 277V(%):</b>	N/A
<b>Efficacy:</b>	61
<b>Ambient Temperature (°C):</b>	25.0
<b>Stabilization Time (Hours):</b>	1:00
<b>Total Operating Time (Hours):</b>	1:45
<b>Off State Power(W):</b>	0.00

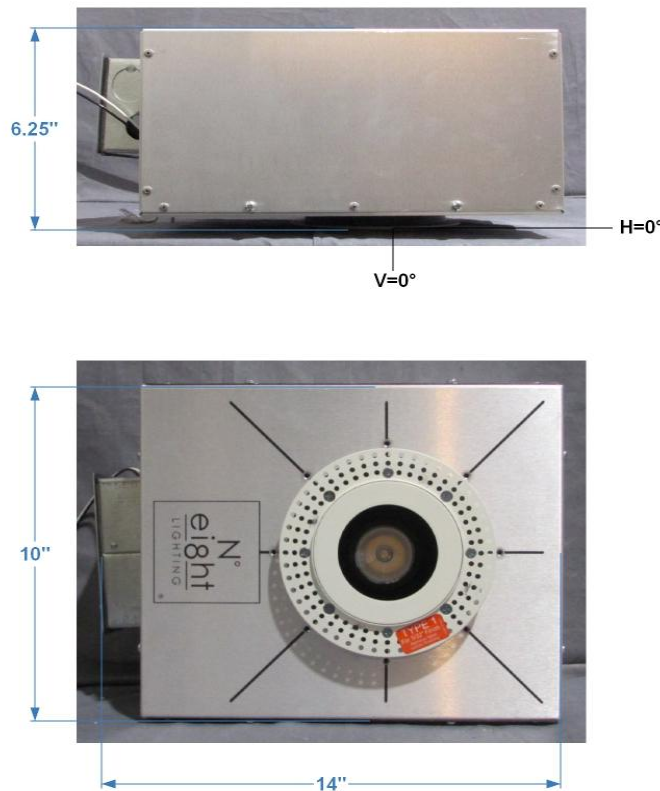


FIG.1 LUMINAIRE

\*All Results in accordance to IESNA LM-79-2008: Approved Method for the Electrical and Photometric Testing of Solid-State Lighting.

## Test Methods

### Photometric Measurements - Goniophotometer

A Custom Light Laboratory Type C Rotating Mirror Goniophotometer was used to measure candelas(intensity) at each angle of distribution as defined by IESNA for the appropriate fixture type.

Ambient temperature is set to 25°C and is measured from the center of the fixture, within 1ft from the outside of the fixture. Temperature is maintained at 25°C throughout the testing process and the sample is stabilized for at least 30mins and longer as necessary for the sample to achieve stabilization.

Electrical measurements are measured using the listed equipment.

### Spectral Measurements - Integrating Sphere

A Sensing Spectroradiometer SPR-3000, in conjunction with Light Laboratory 2 meter integrating sphere was used to measure chromaticity coordinates, correlated color temperature(CCT) and the color rendering index(CRI) for each sample.

Ambient temperature is set to 25°C and is measured from the center of the fixture, within 1ft from the outside of the fixture. Temperature is maintained at 25°C throughout the testing process and the sample is stabilized for at least 30mins and longer as necessary for the sample to achieve stabilization.

Electrical measurements are measured using the listed equipment.

### Disclaimers:

This report must not be used by the customer to claim product certification, approval or endorsement by NVLAP, NIST or any agency of Federal Government.

Report Prepared by : Dennis Malonzo

Test Report Released by:



Jeff Ahn  
Engineering Manager

Test Report Reviewed by:



Steve Kang  
Quality Assurance

*\*Attached are photometric data reports. Total number of pages: 9*



8165 E. Kaiser Blvd. Anaheim, CA 92808  
 p. 714.282.2270  
 f. 714.676.5558

# Photometric Test Report

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : L101605110.IES**

**DESCRIPTION INFORMATION (From Photometric File)**

IESNA:LM-63-2002  
 [TEST] L101605110  
 [TESTLAB] LIGHT LABORATORY, INC.  
 [ISSUEDATE] 11/03/2016  
 [MANUFAC] Number Eight Lighting Company  
 [LUMCAT] 803/K2-HI-40-XX/DIM1-8-1000/FR-LG-P-1-WH/NL  
 [LUMINAIRE] LED Recessed Fixed Position Downlight, 40° Beam Spread, 2.75" DIAMETER Aperture Trim  
 [BALLASTCAT] INTUITIVE SYSTEMS ISD-601-1050-15-D  
 [LAMPPOSITION] 0,0  
 [LAMPCAT] N/A  
 [OTHER] INDICATING THE CANDELA VALUES ARE ABSOLUTE AND  
 [MORE] SHOULD NOT BE FACTORED FOR DIFFERENT LAMP RATINGS.  
 [INPUT] 120VAC, 15.07W  
 [TEST PROCEDURE] IESNA:LM-79-08

**CHARACTERISTICS**

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	913
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	61
Total Luminaire Watts	15.07
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	0.62
Spacing Criterion (90-270)	0.62
Spacing Criterion (Diagonal)	0.62
Basic Luminous Shape	Circular
Luminous Length (0-180)	0.23 ft (Diameter)
Luminous Width (90-270)	0.23 ft (Diameter)
Luminous Height	0.00 ft

**LUMINANCE DATA (cd/sq.m)**

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	21048	21048	21048
55	6769	6769	6769
65	1837	1837	1837
75	2000	2000	2000
85	2970	2970	2970

IES INDOOR REPORT  
PHOTOMETRIC FILENAME : L101605110.IES

CANDELA TABULATION

	<u>0</u>
0.0	1860
1.0	1857
3.0	1830
5.0	1777
7.0	1699
9.0	1594
11.0	1469
13.0	1335
15.0	1195
17.0	1047
19.5	856
22.5	644
25.5	481
29.0	345
33.0	224
37.5	131
42.5	74
47.5	41
55.0	15
65.0	3
75.0	2
85.0	1
90.0	1

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : L101605110.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	472.40	N.A.	51.70
0-30	708.64	N.A.	77.60
0-40	823.44	N.A.	90.20
0-60	899.79	N.A.	98.50
0-80	910.90	N.A.	99.80
0-90	913.07	N.A.	100.00
10-90	779.49	N.A.	85.40
20-40	351.05	N.A.	38.40
20-50	409.45	N.A.	44.80
40-70	84.88	N.A.	9.30
60-80	11.11	N.A.	1.20
70-80	2.57	N.A.	0.30
80-90	2.17	N.A.	0.20
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	913.07	N.A.	100.00

Total Luminaire Efficiency = N.A.%

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	133.58
10-20	338.82
20-30	236.24
30-40	114.80
40-50	58.40
50-60	17.95
60-70	8.54
70-80	2.57
80-90	2.17
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : L101605110.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0	
	RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	0
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94	0
2	108	104	100	97	106	102	98	95	99	96	93	96	93	91	93	91	89	88	0
3	103	97	92	89	101	96	91	88	93	90	87	91	88	85	89	86	84	82	0
4	99	91	86	82	97	90	85	82	88	84	81	86	83	80	84	81	79	77	0
5	94	86	81	77	92	85	80	76	83	79	76	82	78	75	80	77	74	73	0
6	90	81	76	72	88	81	75	72	79	75	71	78	74	71	77	73	70	69	0
7	86	77	72	68	85	77	71	67	75	71	67	74	70	67	73	69	66	65	0
8	82	73	68	64	81	73	67	64	72	67	63	71	66	63	70	66	63	62	0
9	79	70	64	61	78	69	64	60	68	64	60	68	63	60	67	63	60	59	0
10	76	67	61	58	75	66	61	58	65	61	57	65	60	57	64	60	57	56	0

POLAR GRAPH

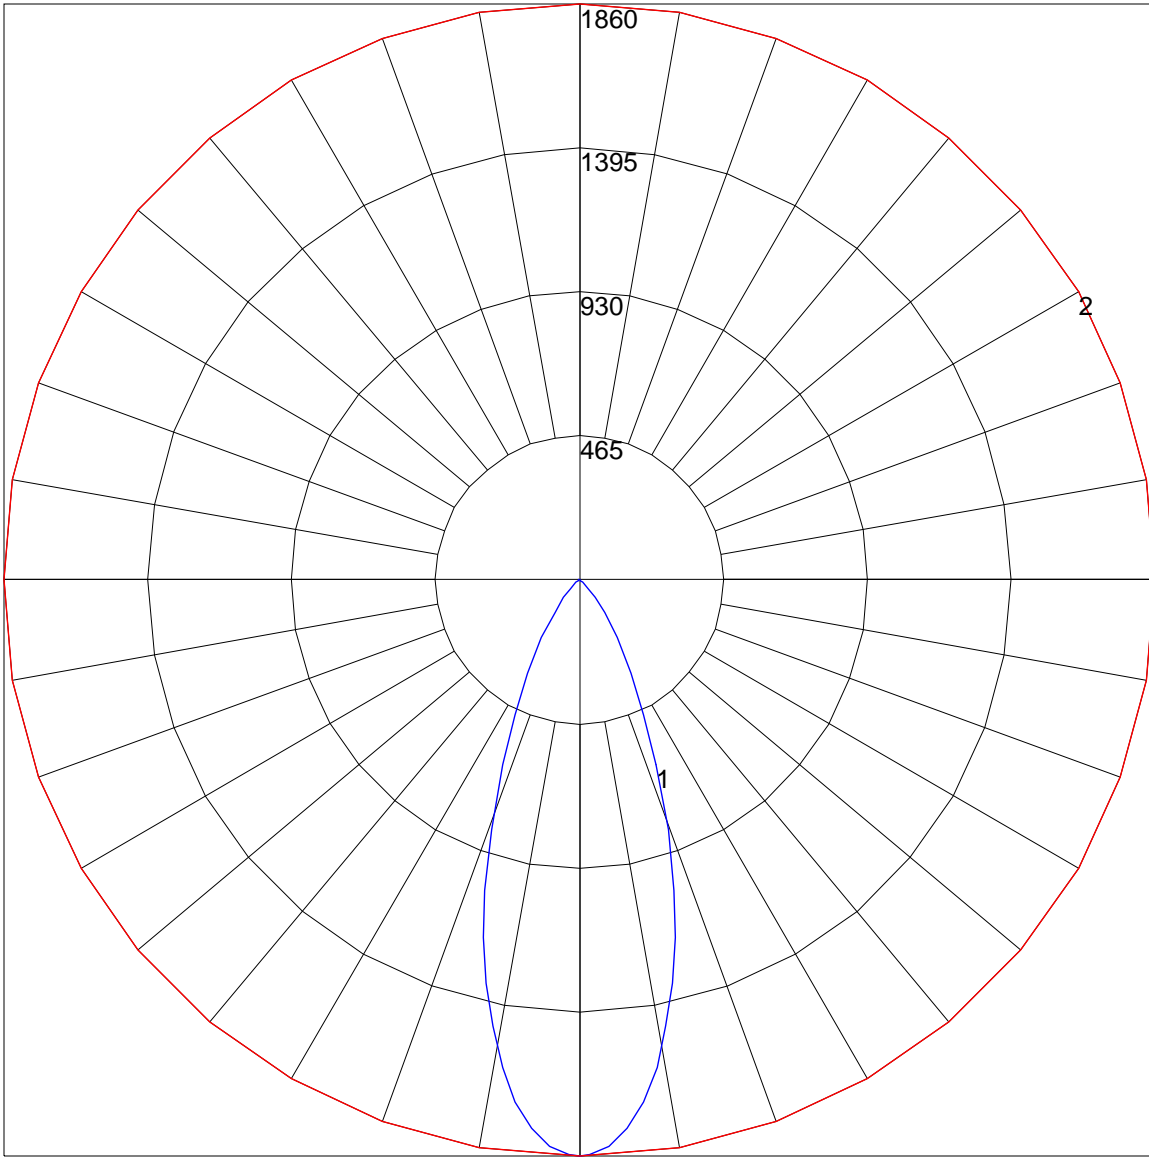

Maximum Candela = 1860 Located At Horizontal Angle = 0, Vertical Angle = 0  
# 1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (0) (Through Max. Cd.)



## SAMPLE Illuminance cone diagram

Mounting Height = 12 ft.

